


**System No. C-AJ-2535**

T Ratings - 0 Hr

F Rating - 3 Hrs

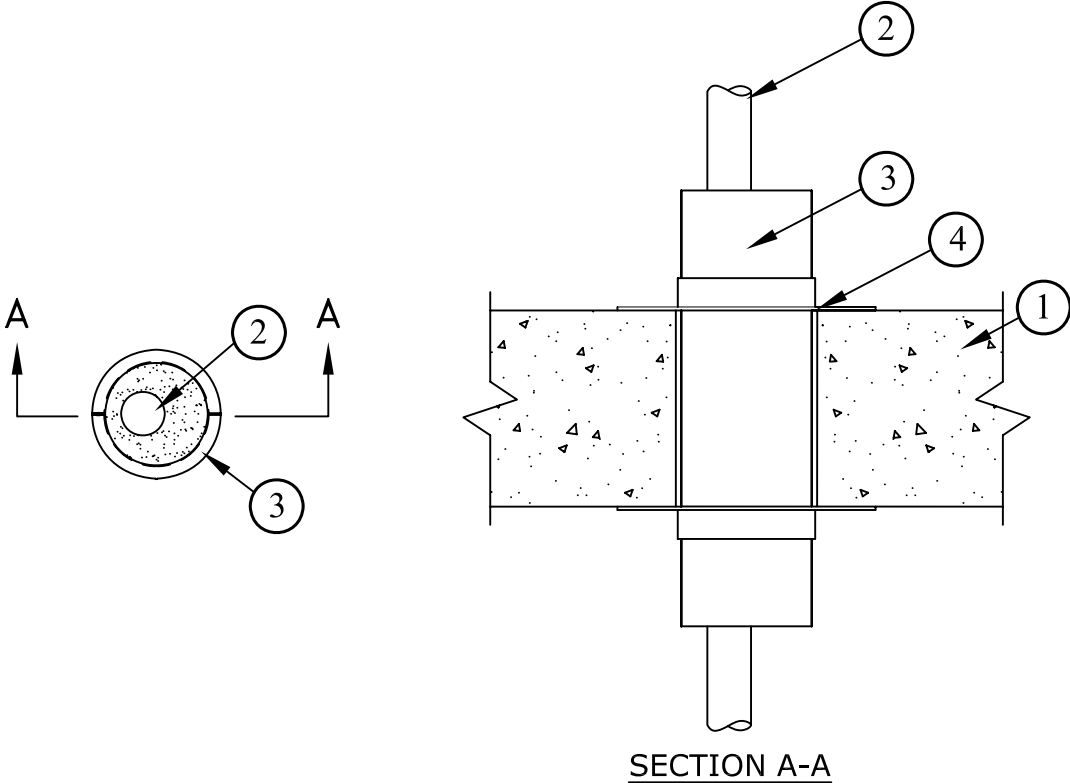

- 1. CONCRETE FLOOR ASSEMBLY
- 2. THROUGH PENETRANT
- 3. ABESCO CT 120/R CABLE TRANSIT
- 4. ABESCO CP 310 FR ACRYLIC INTUMESCENT CAULK