


System No. F-C-3089

T Ratings -1 Hr

F Rating - 1 Hr

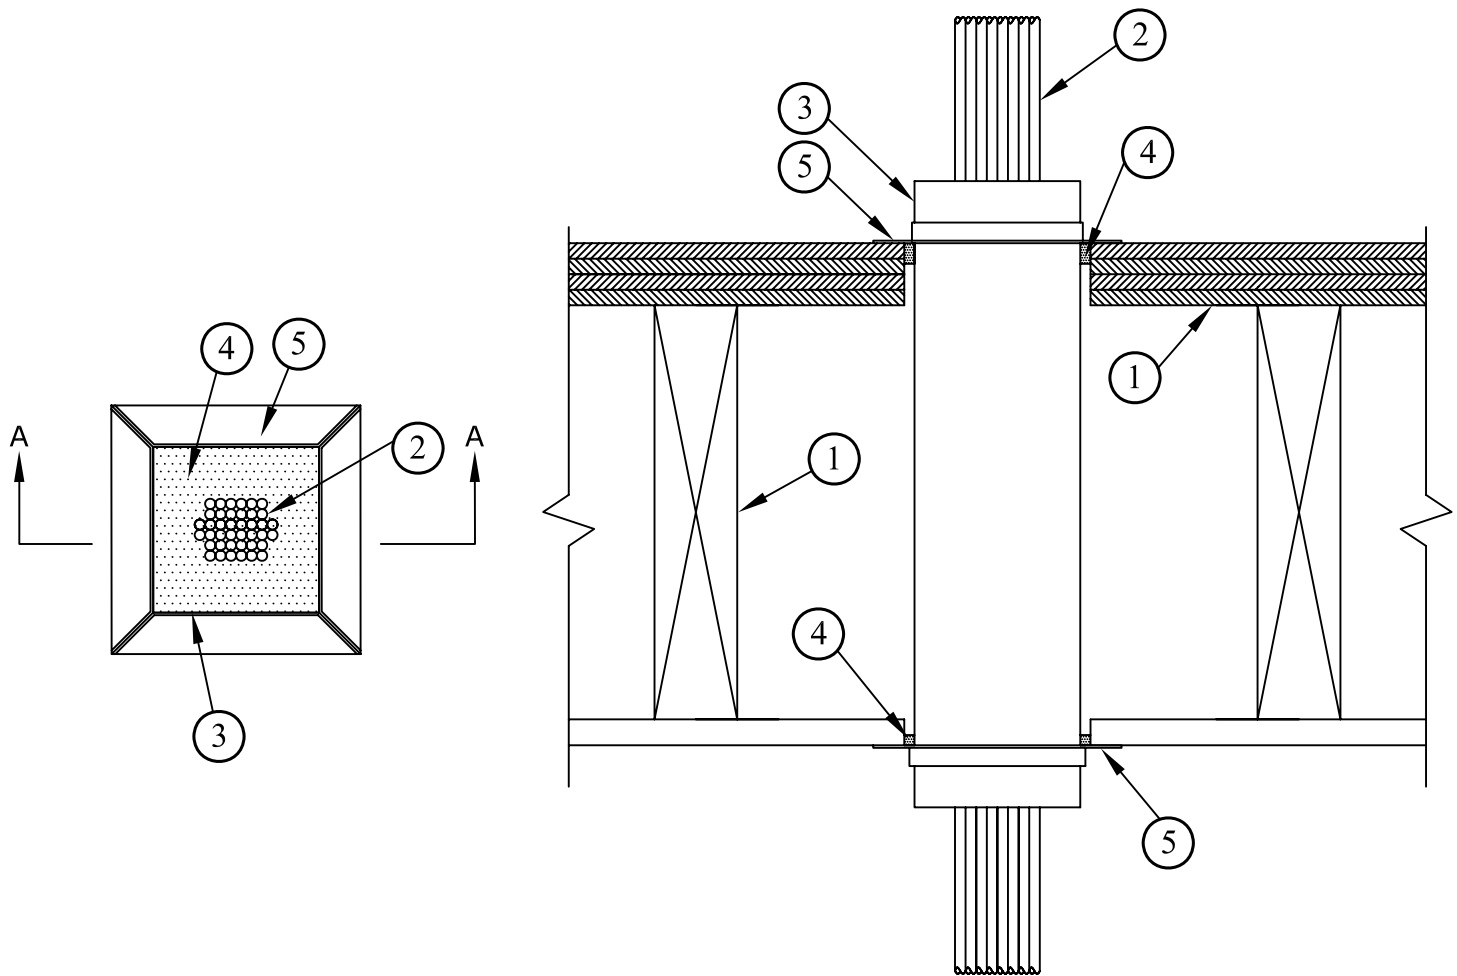

SECTION A-A

1. FLOOR ASSEMBLY
2. CABLES
3. ABESCO CT 120/ E CABLE TRANSIT
4. ABESCO CP310 FR ACRYLIC INTUMESCENT CAULK
5. MOUNTING FLANGES